

CUSTOMER APPROVAL

NAME: _____


DATE: _____

IMPORTANT: BY SIGNING THIS DRAWING YOU ARE APPROVING IT AS IS. IF CHANGES ARE REQUIRED, A NEW DRAWING WILL BE REQUIRED.


NOTES:

1. DAY TANK PACKAGE INCLUDES 12 GAUGE STEEL, RUST PROOFED INTERIOR, PRIMED AND FINISHED PAINTED _____ W/ COVER. TANK PRESSURE TESTED FROM 3.5 TO 5.0 PSI.
2. APPROXIMATE DRY WEIGHT = 206 LB.
3. FOR DETAILS ON THE SYSTEM 2000 PLUS SEE SEPERATE SPECIFICATIONS SHEET.
4. SEE PUMP SPECIFICATION SHEET FOR MORE DEFAULTS. SEE PUMP LIFT WORK SHEETS FOR ADDITIONAL INFORMATION ON PUMP HEAD AND LIFT.
5. OPTIONS (CHECK IF REQ'D)


- ____ WEATHERPROOF BASIN
- ____ 2" NPT NORMAL VENT (2252)
- ____ 2" NPT EMERGENCY VENT (2262)
- ____ OTHER _____
- ____ OTHER _____

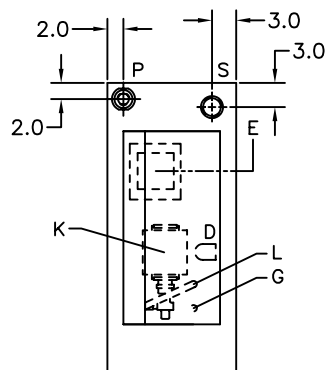


TOP VIEW

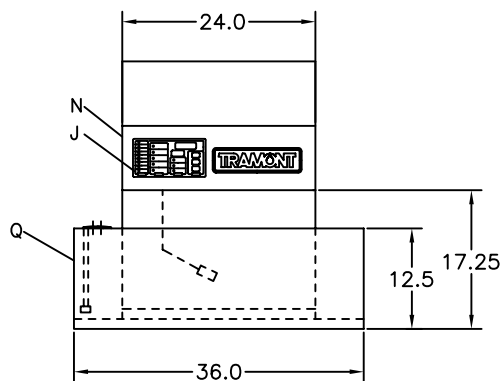

FRONT VIEW

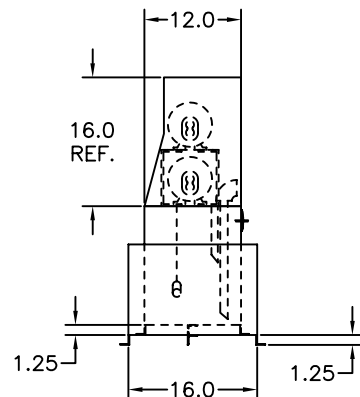

SIDE VIEW

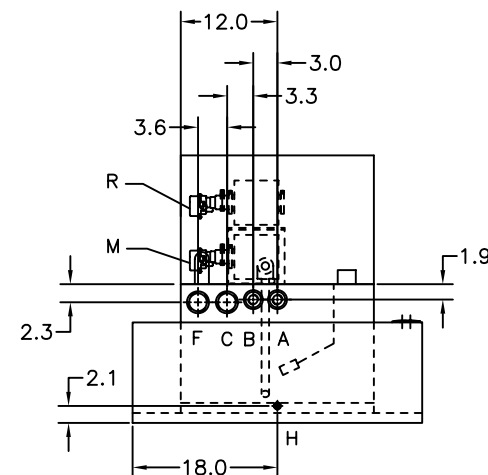

REAR VIEW

| LET | FITTING DESCRIPTION |
|-----|---|
| A | 1" NPT FUEL RETURN |
| B | 1" NPT OVERFLOW GRAVITY FEED TO MAIN TANK |
| C | 2" NPT FOR NORMAL VENT |
| D | 1" NPT ENGINE SUPPLY DIP TUBE |
| E | ELECTRICAL INPUT |
| F | 2" NPT FOR TANK EMERGENCY VENT |
| G | 3/8" DIP TUBE FOR REVERSE PUMP (7" LONG) |
| H | 3/8" NPT FOR DRAIN |
| J | SYSTEM 2000 PLUS - UL 508 (SEE NOTE #3) |
| K | (2) MOTOR, 1/3HP, 115VAC, 1PH, 60HZ |
| L | 3/8" NPT FITTING |
| M | PUMP, 2 GPM HIGH LIFT (SEE NOTE #4) |
| N | REMOVABLE NON-CONDUCTIVE COVER |
| P | RUPTURE BASIN ALARM |
| Q | RUPTURE BASIN - 150% |
| R | 4 GPM REVERSE PUMP (SEE NOTE #4) |
| S | 2" NPT FOR BASIN EMERGENCY VENT |

THIS DESIGN IS THE CONFIDENTIAL PROPERTY OF TRAMONT CORPORATION. FOR USE BY TRAMONT CORPORATION CUSTOMERS FOR SUBMITTAL PURPOSES ONLY. COPYRIGHT TRAMONT CORPORATION, 1998.

| LETTER | DATE | DESCRIPTION | NAME |
|------------------|----------|---------------------------|------|
| B | 02/03/04 | CHANGED NORMAL VENT NOTES | RCS |
| A | 03/29/02 | START | JHP |
| CHANGE BLOCK (S) | | | |

TRAMONT CORPORATION

| | | | |
|----------------|--------------------|-----------------|---------------|
| SCALE: NTS | FRACTIONS = +/- .5 | .XX = +/- .125 | DRAWN BY: JHP |
| DATE: 03/29/02 | .X = +/- .250 | .XXX = +/- .062 | SALES ENG |

| | |
|--|----------------------|
| DESCRIPTION: UTRS-15 DAY TANK WITH WEATHER P BASIN | DRAWING NO. 127-0810 |
|--|----------------------|